


## UNIT-3

### VARIOUS ILLUMINATION METHODS

#### GASEOUS DISCHARGE LAMPS:

Incandescent lamp suffers from two disadvantages –low efficiency and coloured light. The gaseous discharge lamps have been developed to overcome these drawbacks.

The basic principle of a gas discharge lamp is illustrated in the following fig. Gases are normally poor conductors, specially at atmospheric and higher pressure, but application of suitable voltage, called the ignition voltage, across the two electrodes can result in a discharge through gas, which is accompanied by electro-magnetic radiation. The wave length of this radiation depends upon gas, its pressure and the metal power used in lamp. Argon gas and sodium and mercury vapours are commonly employed in the manufacture of gaseous discharge lamps.

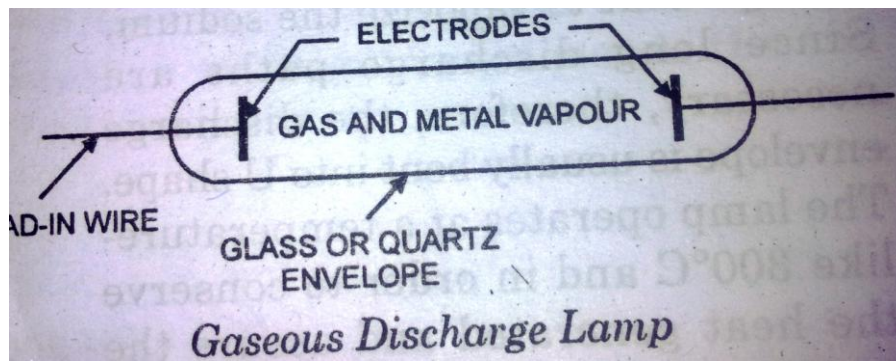

Once the ionization has commenced in the gas, it has the tendency to increase continuously accompanied by a fall in the circuit resistance i.e. gaseous discharge lamp possesses a negative resistance characteristics. In order to limit the current to a safe value use of a choke or ballast is made. The choke performs the dual functions of providing the ignition voltage initially and limiting the current subsequently. Since due to use of choke the power factor becomes poor (0.3-0.4), therefore in order to improve the power factor of the gaseous discharge lamp use of a condenser is made. The light spectrum obtained is, however discontinuous (i.e. it consists of one or more coloured lines). The colour of the light obtained depends upon the nature of the gas or vapour used


Discharge lamps are of two types:

- i. Those which give the light of the same colour as produced by the discharge through the gas or vapour such as sodium vapour, mercury vapour and neon gas lamps.
- ii. Those which are the phenomenon of fluorescence and are known as fluorescent lamps. In these lamps the discharge through the vapour produces ultra violet waves which cause fluorescence in certain materials called as phosphor. The inside of the fluorescent lamps is coated with a phosphor which absorbs invisible ultra- violet rays and visible rays. example is fluorescent mercury vapour –tube.

The gaseous discharge lamps are in general, considered superior to metal filament lamps. However, they suffer from the following drawbacks.

- a. High initial cost and poor power factor.
- b. Starting is somewhat complicated requiring starters in some cases and transformer in others.
- c. These take time to attain full brilliancy.
- d. Ballasts are necessary for stabilizing the current since such lamps have negative resistance characteristic.
- e. Light output fluctuates at twice the supply frequency. The flicker causes stroboscopic effect.
- f. These lamps can be used only in particular position.

1) **Sodium vapour lamp (SV LAMPS)** : scientists have long been familiar with the fact that high luminous efficiencies could be obtained by the use of sodium vapour as a source of light. The development of a practical lamp of this type, however, was delayed since ordinary glass cannot withstand the chemical action of hot sodium. With the development of special resistant glass, the sodium vapour lamp has now reached the practical stage.

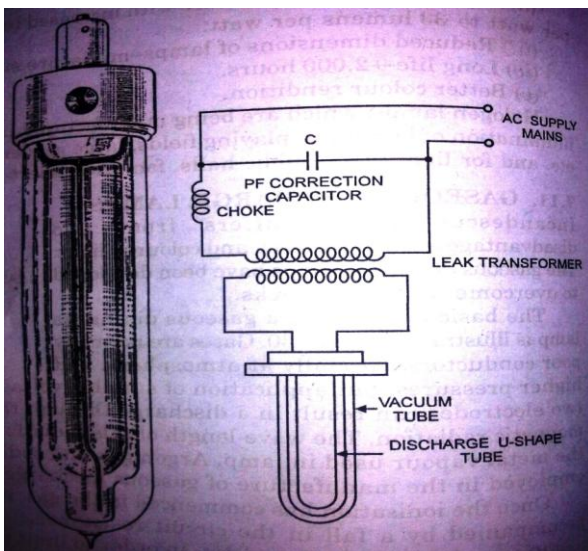

Principally the sodium vapour consists of a bulb containing a small amount of metallic sodium, neon gas, and two sets of electrodes connected to a pin type base. The presence of neon gas serves to start the discharge and to develop enough heat to vapourize the sodium. Since long discharge paths are necessary, therefore the discharge envelope is usually bent into 'U' shape. The lamp operates at a temperature like  $300^{\circ}$  in order to conserve the heat generated and assure the lamp operating at normal air temperature the discharge envelope is enclosed in a special vacuum envelope designed for this purpose. The lamp must be operated horizontally, or nearly so, to keep the sodium well spread out along the tube, although some special lamps may be operated vertically, lamp cap up. Care should be taken in handling these lamps, particularly when replacing inner U-tube, for if it is broken and sodium comes in contact with moisture fire will result.

The sodium lamp is only suitable for alternating current, and therefore requires choke control. This requirement is met by operating the lamp for a stray field step-up –tapped transformer with an open circuit secondary

voltage of 470 to 480 volts. The uncorrected power factor is very low, about 0.3 , and a capacitor must be used to improve the power factor .

When the lamp is not in operation , the sodium is usually in the form of solid deposited on the side walls of the tube, therefore at first when it is connected across the supply mains the discharge takes place in the neon gas and gives red-orange glow. The metallic sodium gradually vapourizes and then ionizes, thereby producing the characteristic mono-chromatic yellow light, which makes object appear as grey. The lamp will come up to its rated light output is approximately 15 minutes. It will restart immediately should the power supply be momentarily interrupted since the presence of vapour is quite low and the voltage sufficient to restrike the arc.

The efficiency of a sodium vapour lamp under practical conditions is about 40-50 lumens/watt . The major application of type of lamp is for high way and general outdoor lighting where colour discrimination is not required, such as street lighting, parks, railyards, storage yards etc. Such lamps are manufactured in 45, 60, 85, and 140watt ratings. The average life is about 3000 hours and is not affected by voltage variations. At the end of this period the light output will be reduced by 15% due to ageing.

The lamp fails to operate when

- (i) The filament breaks or burns out.
- (ii)The cathode stops to emit electrons,
- (iii)The sodium particles mat concentrate on one side of the tube,
- (IV)The lamp tube is blackened owing to sodium vapour action on the glass, in which case the output will be reduced.


### **HIGH PRESSURE MERCURY VAPOUR LAMP(MV LAMPS):**

The extension use of the mercury vapour lamp depends entirely upon the versatility of the mercury vapour as regards pressure, temperature, voltage and other characteristics, each change resulting in a lamp of different spectral quality and efficiency.

The mercury vapour lamp is similar in construction to the sodium vapour lamp. It consists of a discharge envelope enclosed in an outer bulb of ordinary glass. The discharge envelope may be of hard glass or quartz. The space between the bulb is partially or completely evacuated to prevent heat loss by convection from the inner bulb. The outer bulb absorbs harmful ultra-violet rays. The inner bulb contains argon and a certain quantity of mercury. In addition to two main electrodes a starting electrode is connected through a high resistance is also provided. The main electrodes are made of tungsten wire in the shape of helices. In this case no separate heater is required for the cathode which is heated by the constant bombardment of the heavy mercury ions.

The lamp has to heavy auxiliary equipment for use with standard mains voltage, and the necessary connections are shown in following fig. The choke is provided to limit the current for a safe value. This choke lowers the power factor, so a capacitor is connected across circuit to improve the power factor. These lamps must be operated vertically, since if they horizontally convection will cause the discharge to touch the glass bulb, which will fail. Lamps

which are intended to operate horizontally are fitted with a magnetic device which will hold the luminous column central.

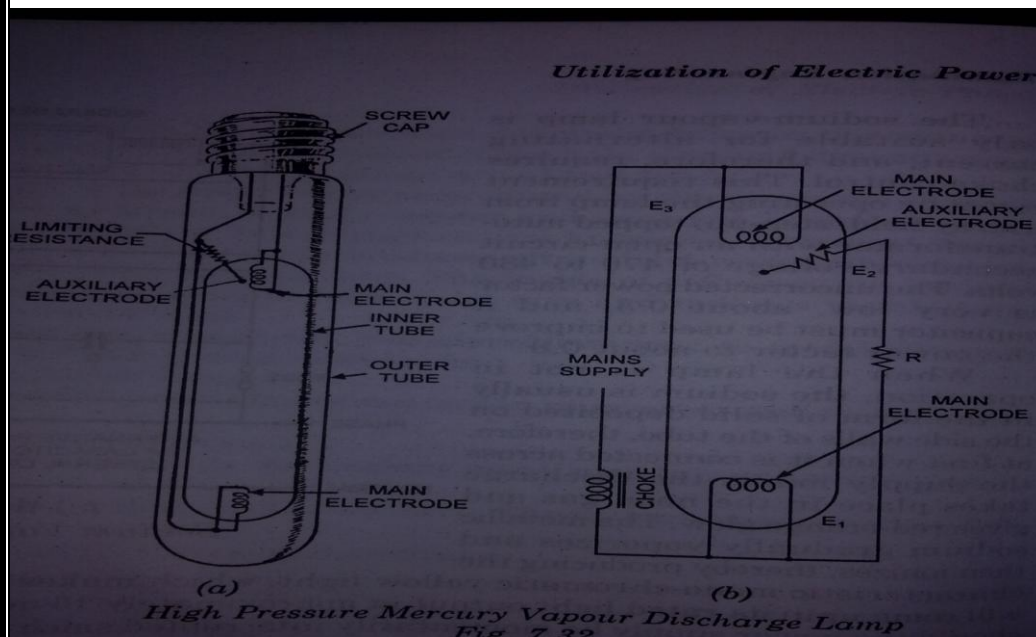

When the supply is switched on, full mains voltage is applied between the auxiliary electrode and neighbouring main electrode; this breaks down the gap and a discharge through the argon takes place. This enables the main discharge to commence. As the lamp warms up, mercury is vapourised, increasing, the vapour pressure and the luminous column becomes brighter and narrower. The lamp requires 4 or 5 minutes to attain full brilliancy. If the supply is interrupted, the lamp must cool down and the vapour pressure be reduced before it will start. This takes 3 or 4 minutes. The temperature of operation inside the inner bulb is about  $600^{\circ}\text{C}$ . It gives greenish blue colour light, which causes colour distortion. The efficiency is about 30-40 lumens/watt. These lamps are manufactured in 250 and 400 watt ratings for use on 200-250 volts a.c. supply mains. The pressure of vapour in lamps is 2-3 atmosphere. lamps of this type are used for general industrial lighting, railway yards, ports, work areas, shopping centers, etc, where greenish blue colour light is not objectionable.

The lamp described above is M.A. type. Another type, which is manufactured in 300 and 500 watt rating for use on a.c. as well as d.c. supply mains, is M.A.T type. This is similar to M.A. type except that choke is not used as a blast. Space between two tubes instead of being evacuated contains a tungsten filament in series with a discharge tube which acts as a blast. When the supply is switched on, it operates as filament lamp, its full output being given by the outer tube. At the same time the discharge or inner tube beings warming up and at a particular temperature a thermal switch operates cutting a part of the filament and there by increasing the voltage across the discharge tube. The filament contributes a considerable portion of red rays. The combination of red rays from the filament and the blue radiations from the discharge tube produce a useful colour. As the filament acts as a resistance, the overall power factor of the lamp is about 0.95 and therefore capacitor is not required.

Lower wattage lamps, such as 80 and 125 watts, are manufactured in a different design and using high vapour pressure of about 5-10 atmosphere. These are known as M.B. types. These operate in a manner similar to M.A. type except that resistance in series with starting electrode is large and outer



bulb is of quartz, in order to withstand high temperature so that these lamps can be used in any position.

### **MERCURY IODIDE LAMP:**

These lamps are similar in construction to high temperature mercury vapour lamps but in addition to mercury, a number of iodides are added which fill the gaps in the light spectrum, and thus improve the colour characteristics of the light. Their efficiency is also higher (75-90 lumens/watt). A separate ignition device, in addition to the choke, is required for the mercury iodided lamp. Such lamps are suitable for application in the fields of flood lighting, industrial lighting and public lighting.

### **NEON LAMPS:**

It is cold cathode lamp and consists of a gas bulb filled with a neon gas with a small percentage of helium. These lamps give to orange pink coloured light. Electrodes are of pure iron and are spaced only few mm apart so that lamp can be made for voltages as low as 110 volts a.c. or 150 volts d.c. For use on a.c. the electrodes are of equal size. On d.c. the gas glows near the negative electrode, therefore negative electrode is larger in size. The efficiency of neon lamp lies between 15-40 lumens/watt. Owing to discharge of gas between the electrodes in the form of an arc, it may cause the current drawn by the lamp to increase indefinitely. This is prevented by connecting a high resistance of few thousand ohms in series and mounting it in the cap. The lamp of this type is of the size of an ordinary incandescent lamp. The power consumption is of the order of 5watts.

Neon lamps are used as indicator lamps, night lamps, for determination of polarity of d.c. mains in larger size as neon tubes for the purpose of advertising.

### **NEON TUBES:**

The popularity of high voltage neon lighting arose almost entirely from its use in advertising, for signs, or in decorative treatment of buildings, but later the lighting field become important. The neon tube, which is used in varying lengths upto about 8 meters, may be bent almost any desired shape during manufacture . It consists of a length of glass tubing containing two electrodes, normally cylindrical in shape, of iron , steel, or copper.

The true neon tube contains neon, but the term is now used also for tubes with fillings of other rare gases. By varying the composition of glass and adding different substances to neon gas different colours such as orange, red, yellow and green etc. are obtained. The diameters of tube vary and common sizes of 10,15, 20, and 30mm carry currents of 25, 35,60,150mA respectively. Voltage required may vary from 300v to 1000v per meter of tube length for starting and discharge a striking voltage, about  $1\frac{1}{2}$  times this value is required. Such voltage is obtained by making use of step up transformer having a high leakage reactance so that it gives a dropping characteristics. The usual operating voltage is 6000 volts.

The tubes are mounted either on a wooden frame or a metal base. These are matched with step –up transformers by connecting suitable transformers by connecting suitable tappings for the rated current. Connections between letters are made by nickel wires, the glass tubings being slipped over them.

The power factor of neon tubes is quite low and is improved by using capacitors. The capacitors can, however, be placed only on the low voltage side of the transformer

### **FLUORESCENT TUBES:**

Fluorescent lighting has a great advantage over other light sources in many applications. The tubes can be obtained in a variety of length, with illumination in a variety of colours. It is possible to achieve quite high lighting intensities without excessive temperature rise and owing to the nature of light sources, the danger of glare is minimized. The efficiency of the fluorescent tube is about 40 lumens per watt, about three times the efficiency of an equivalent tungsten filament lamp. The fluorescent tube consists of a glass tube 25mm in diameter and 0.38m-1.52m in length. The inside surface of the tube is coated with the thin layer of fluorescent material in the form of a powder.

The coating materials used depend on the colour effect desired and may consist of a zinc silicate, cadmium, silicate or calcium tungstate. These organic chemicals are known as *phosphorus* which powder transforms short wave invisible radiation into visible light. By mixing the various powders light of any desired colour including day light can be obtained. The tube contains small quantity of argon gas at a pressure of 2.5mm of mercury and one or two drops of mercury. It is provided with two electrodes coated with electron emissive material. A starting switch is provided in the circuit, which puts the electrodes directly across the supply mains at the time of starting, so that electrodes may get heated and emit sufficient electrons. A stabilizing choke is connected in series with it, which acts as a ballast.

Fluorescent tubes are available in the following sizes

<b><u>Length</u></b>	<b><u>wattage</u></b>
38 cm	14W
46 cm	15W
61 cm	20W
100 cm	25W
122 cm	40W
152 cm	65W

The starting switches are of two types, namely thermal type and glow type.

### **Thermal starter type:**

The thermal starter is a current operating device and consists of two metallic strips and a heater coil. The bimetallic strips are in contact with each other when the lamp is not in operation. When the supply is switched on, the two electrodes get connected in series through the thermal switch the relatively large current raising them to incandescence. The current also flows through the heater element as a result of which bimetallic strips break contact. This causes interruption in the current flowing through the circuit, which further results in a high voltage surge across the electrodes of the tube, which is enough to strike the arc between the electrodes. This arc is then maintained by the normal lamp voltage. The thermal switch is now generally obsolete because of its more complicated construction, greater cost and greater power loss.

### **GLOW STARTER TYPE:**

The connections of the fluorescent tube incorporating a glow type starter are shown in the above figure. The glow type starter is a voltage operated device and consists of two bimetallic electrodes enclosed in a glass bulb filled with a mixture of helium and hydrogen. Normally the contacts are open. When the supply is switched on, the potential across the bimetallic electrodes cause a similar glow discharge at a small current not enough to heat up the tube electrodes. This discharge is enough, however, to heat the bimetallic strips of the causing them to bend and make contact. The result is a large current through the electrodes, their temperature being raised to incandescence and the gas in the immediate neighborhood is ionized. After one or two seconds the bimetallic strips cool down and the contacts are open. This opening of contacts in series with the choke causes a momentary high voltage, which is sufficient to start the discharge in the main tube. The starter starts to glow as the voltage is now too low. A small capacitor is placed inside the starter to suppress arcing and radio interference.

Now a days starter less circuits are there for instant start or rapid start.

### **FLUORESCENT LAMPS FOR DC SUPPLY:**

In the foregoing discussions it has been assumed that the supply to the fluorescent lamps is a.c. if however, the available supply is d.c. some special accessories and circuit modification will be required.

- (i) The choke coil has a low impedance in d.c. and therefore, a ballast resistance is connected in series with the choke in order to limit the current.
- (ii) On systems below 220v, starting becomes less certain on d.c. only thermal type starters should be used.
- (iii) The positive end becomes relatively dark on account of the tendency of mercury vapour to migrate towards the negative end of the tube. In order to avoid this problem a reversing switch is included in the circuit between the supply and the fitting like as shown in the following figure.

In d.c. operation of fluorescent tube there is no problem of power factor correction and no stroboscopic effect. Its disadvantages are low efficiency due to loss in ballast resistance, increased cost of the ballast resistance and reversing switch and less life of the tube.

### **Basic Principles of light control:**

When light falls on a surface, depending upon the nature of the surface, some portion of light energy is reflected, some portion is transmitted through the medium of the surface and the rest is absorbed. The ratio of reflected light energy to the incident light energy is known as reflection factor.

There are two basic types of reflection (i) mirror or specular reflection and (ii) Diffuse reflection.

In case of specular reflection a beam of light is reflected but not scattered, and unless the eye is placed in the path of the reflected beam, the viewer is unaware of the existence of light. Moreover, if his eye is placed in the path of the reflected reflection are silvered mirrors, highly polish metals etc. with diffuse reflection the reflected light is scattered in all directions, and the viewer sees the illuminated surface, not the light source. Surfaces causing diffuse reflection are paper, frosted glass, chalk, dry earth, plaster etc. If a surface that is uniformly illuminated by a beam of light appears to be equally bright when viewed from all possible angles the reflection is said to be perfectly diffuse, perfect mirror surfaces and perfect diffusing surfaces are ideals that do not exist in nature. The reflection from any actual surface is partly specular and partly diffuse, the proportions varying widely. A surface that is almost free from mirror reflection is called a mat surface.

### **TYPES OF LIGHTING SCHEMES:**

The distribution of the light emitted by lamps is usually controlled to some extent by means of reflectors and translucent diffusing screens, or even lenses.

The interior lighting schemes may be classified as (i) direct lighting (ii) semi-direct lighting (iii) semi-indirect lighting (iv) indirect lighting and (v) general lighting.

**Direct lighting** : It is most commonly used type of lighting scheme. In this lighting scheme more than 90 % of total light flux is made to fall directly on the working plane with the help of deep reflectors. Though it is most efficient but causes hard shadows and glare. It is mainly used for industrial and general outdoor lighting.

**Semi-direct lighting** : In this lighting scheme 60-90 % of the total light flux is made to fall downwards directly with the help of semi-direct reflectors, remaining light is used to illuminate the ceiling and walls. Such a lighting system is best suited to rooms with high ceiling where a high level of uniformly distributed illumination is desirable. Glare in such units is avoided by employing diffusing globes which not only improve the brightness towards the eye level but improve the efficiency of the system with reference to the working plane.

**Semi-indirect lighting** : In the lighting scheme 60-90 % of total light flux is thrown upwards to the ceiling for diffuse reflection and the rest reaches the working plane directly except for some absorption by the ceiling. This lighting scheme is with soft shadows and glare free. It is mainly used for indoor light decoration purposes.

**Indirect lighting** : In this lighting scheme more than 90% of total light flux is thrown upwards to the ceiling for diffuse reflection by using inverted or bowl reflectors. In such a system the ceiling acts as the light source, and the glare is reduced to minimum. The resulting illumination is softer and more diffused, the shadows are less prominent and the appearance of the room is much improved over that which results from direct lighting. It is used for decoration purposes in cinemas, theatres and hotels etc. and in work shops where 'large machines and other obstructions would cause troublesome shadows if direct lighting is employed.

**General lighting** : In this scheme lamps of diffusing glass are used which give nearly equal illumination in all directions.

### **Design of lighting schemes:**



The lighting scheme should be such that it may,

1. Provide adequate illumination,
2. Provide light distribution all over the working plane as uniform as possible,
3. Provide light of suitable colour and
4. Avoid glare and hard shadows as far as possible.

The following factors are required to be considered while designing the lighting schemes.

- I. **Illumination Level** : This is the most vital factor because a sufficient illumination is the basic means where by we are able to see our surroundings, unless they are themselves light sources, since only when illuminated do the objects take on the necessary brightness. It is the task of illumination to give objects a distributed brightness. Body colours have property of reflection light in different degrees. It is this differential brightness which gives essential perception of details. For each type of work there is a range of brightness most favorable to output i.e which causes minimum fatigue and gives maximum output in terms of quality and quantity. Degree of illumination, to be seen and its distance from the observer—greater the distance of the object from observer and smaller the size of the object, greater will be the illumination required for its proper perception and Contrast b/n the object and back ground—greater the contrast b/n the colour of the object and its back ground, greater will be the illumination required to distinguish the object properly. Objects which are seen for longer duration of time require more illumination than those for casual work. Similarly moving objects require more illumination than those for stationary object.

Illumination level required, as per ISI, in various parts of a building is given below

<b>Games or recteation room</b>	<b>100</b>
<b>Kitchen</b>	<b>200</b>
<b>Kitchen sink</b>	<b>300</b>
<b>Laundry</b>	<b>200</b>
<b>Bathroom</b>	<b>100</b>
<b>Bathroom mirror</b>	<b>300</b>
<b>sewing</b>	<b>700</b>
<b>workshop</b>	<b>200</b>
<b>stairs</b>	<b>100</b>
<b>Garage</b>	<b>70</b>

Illumination level required, as per ISI, for various types of traffic routes is given below

Classification of lighting Installation	Type of road	Average level of illuminatuion on road surface
Group A1	important traffic routes carrying fast traffic	30
Group A2	mixed traffic like main city streets, arterial roads, through ways etc. secondary roads with considerable traffic like	15
Group B1	princijpal local traffic routes, shopping streets etc.	8
Group B2	secondary roads with light traffic	4

**(ii) Uniformity of illumination :** The human eye adjusts itself automatically to the brightness within the field of vision. If there is a lack of uniformity, pupil or iris of the eye has to adjust more frequently and thus fatigue is caused to the eye and productivity is reduced. It has been found that visual performance is best if the range of brightness within reduced. It has been found that visual performance is best if the range of brightness within the field of vision is not greater than 3:1, which can be achieved by employing general lighting in addition to localized lighting. A part from the consideration of causing fatigue, local lighting without using matching general lighting creates psychological feeling of loneliness, gloom and unfriendliness. The modern trend is thus towards ‘localized lighting plus general lighting’ and towards the adoption of “ general lighting oriented towards the working surface ‘ especially in mass production factories, offices, drawing offices, shops etc.

**(iii) colour of light :** The appearance of the body colour entirely depends upon the colour of the incident light. In general the composition of the light should be such that the colour appears natural i. e . its appeareance by artificial light is not appreciable different from that by day light. Day- light fluorescent tubes now a-days make it possible to illuminate economically even large spaces with artificial day light giving good colour rendering and at sufficiently high level. For certain applications such as street lighting, colout of light does not matter much if different components have not to be distinguished from each other by their colours, highly efficient discharge lamps, which cause colour distortion, can be used.

iv. **Shadows:** In lighting installations, Formation of long and hard shadows causes faigue of eyes and therore is considered to be a short-coming. Complete absence of shadows altogether again does not necessarily mean an ideal condition of lighting installations. contrary, perhaps to popular opinion, a certain amount of shadow is desirable in artificial lighting as it helps to five shape to the solid objects and makes them easily recognized. Objects illuminated by shadow less light appear flat and un-interesting, contours are lost, and it is difficult for the eye to form a correct judgment of the shape of an object. How’re, there is one exception to this i.e. in drawing offices, where we are to see flat surfaces, shadow less light is essential otherwise shadows will hinder the work. Hard and long shadows can be avoided by (i) using large no of small luminaries mounted at height not less than 2.5 meters and (ii) by

using wide surface sources of light using globes over filament lamps or by using indirect lighting system.

v. **Glare :** It may be direct or reflected i.e it may come directly from the light source or it may be reflected brightness such as from a desk top, nicked machine parts , or calendred paper. Direct glare from a source of light is the more common, and is more often a hindrance to vision. A glance at the sun proves that an extremely bright light source causes acute eye discomfort. Light sources of far less brilliancy than the sun, such as the filament of an incandescent lamp, or the incandescent metal of a gas lamp, also cause discomfort by a direct glare. Reflected glare is which comes to the eyes as glint or reflection of the light source in some polished surface.

vi. **Mounting height:** The mounting height will largely be governed by the type of the building and type of lighting scheme employed. In the case of direct lighting, in rooms of large floor area, the luminaries should be mounted as close to the ceiling as possible. Lowering them not only will make the illumination less uniform, but will also bring them more into the field of vision, thus increasing the glare, without causing an appreciable increase in the coefficient of utilization. In the unusual case of small rooms with high ceilings, there is something to be gained by lowering the luminaires, but even here a better solution might be to use filament lamps with focusing reflectors and to mount them high. In

the case of indirect and semi-indirect lighting, it would of course be desirable to suspend the luminaries far enough down from the ceiling in order to give reasonably uniform illumination on the ceiling. In practice this is usually taken to mean that the length of the suspension tubes should be one-quarter to one-third the horizontal spacing b/n rows of luminaries.

vii. **Spacing of luminaires:** correct spacing is of great importance to provide uniform illumination over the whole area and thus do away with comparatively dark areas which are so often found when the fittings are badly spaced.

In case of direct and semi-direct luminaires the ratio of the horizontal spacing b/n rows to the height of the luminaires above the working plane depends to quite an extent on the candle power-distribution curve of the luminaire. In the case of tungsten lamps combined with focusing reflectors, the ratio of spacing to height should be about 0.6. In the case of

indirect and semi-indirect luminaries. It is good practice to aim at a horizontal spacing b/n rows approximately equal to a height of the ceiling above the working plane, and in no case should the horizontal spacing exceed

$1 \frac{1}{2}$  times this height.

In case of fluorescent luminaries, it is common practice to join two or more luminaries end to end so that they can share a common outlet. In fact it often works out well to use continuous rows of luminaries, especially when the specified illuminating is fairly high.

viii. **Cooler of surrounding walls :** The illumination in any room depends upon the light reflected from the walls and ceilings. White walls and ceiling reflect more light as compared to colored ones.

### **Factory Lighting :**

Adequate lighting of factories is of very importance, as it provides improved amenities for the employees, increased production and has a definite economic value in reducing accidents with their consequent loss of time and compensation payments.

**General Requirements and Types of installations :** A factory lighting installation, in common with other indoor equipments should provide and adequate illumination on the working plane and give a good distribution of light, employ simple and easily cleaned fittings and avoid glare. It is essential not only to avoid glare from the lamp itself but also reflected glare from any polished surface, which may be within the line of vision.

**General lighting :** The usual scheme in factories and workshops is to mount a number of lamps at a sufficient height so that uniform distribution of light over the working plane is obtained. In large machine shops the height is governed by the necessity of keeping the lamps above the travelling crane. In such cases it is often desirable to supplement the main lighting by side lighting in order to give additional illumination on a vertical plane. Since light coloured walls and ceiling add to the effectiveness of an installation, therefore it is necessary to get white washing or painting done,

**Local Lighting :** On some points fairly intense illumination is required for thus purpose local lighting can be provided by means of adjustable fittings attached to the machine or bench in question or mounted on portable floor standard. Such lamps should be mounted in deep reflectors so that glare is avoided.

**Emergency lighting :** Some lights, such as for (i) internal pilot lighting required for safe and speedy evacuation of personnel after main lighting circuit is off (ii) external pilot lighting, provided with careful shades leading to shelters required for evacuation of personnel (iii) for control posts, first aid centres etc. (iv) dials and gauges in important plants required to be watched regularly are required during an air raid when all the factory lights are off as a matter of air raid precaution. The circuit supplying the above emergency light should be independently controlled. It is very desirable to provide auxiliary lighting from the source other than the main electric supply preferably from batteries or from small petrol driven generator set. If however, emergency light circuits are operated from main electric supply, these should be completely separated from main lighting circuit.

**Industrial lighting fittings:** Reflectors for industrial purpose must be simple in design and easily cleaned. The requirements of most of the installations can be met by one of the following types of fittings.

**Standard Reflectors:** These reflectors are made to accommodate lamps of ratings from 40 to 1,500 watts and designed so that they give adequate and uniform illumination when they are mounted at a spacing equal to about 1.5 times their mounting height above the working plane.

**Diffusing Fittings:** When more diffused light is required than that given by the standard reflector a diffusing glass screen may be fixed across a standard type of reflector. Such fittings are used where highly polished articles are dealt with.

**Concentrating Reflectors:** A reflector with a concentrated beam is employed in large machine shops and foundries, where the fittings are to be mounted on a considerable height above the working plane. In such places an ordinary reflector would have too wide angle of divergence and would waste a great deal of light on the walls

**Enclosed Diffusing fittings:** An opal globe completely enclosing the lamp giving a very even and well diffused light is used when light coloured walls and ceiling are there.

**Angle Reflectors:** Angle reflectors are used to provide illumination in a vertical plane when concentrating type reflectors are used. These can be mounted on suitable stanchions or the walls.

**Maintenance:** In order to maintain the fittings in a condition of reasonable efficiency it is necessary to clean the light fittings periodically. The frequency of cleaning depends on the conditions in the particular factory under consideration and varies from once or twice a week for very dirty surroundings to every four or six weeks under the best conditions.

**Types of Lamps :** The discharge lamps have been used in where colour rendering is not important, The fluorescent lamps are widely employed on account of its natural day light colour, its even illumination and absence of glare and in some cases, the fact that it gives rise to considerably less than filament lamps of the same light output.

### **STREET LIGHTING:**

The main objectives of street lighting are

- (i) To make the traffic and obstructions on the road clearly visible in order to promote safety and convenience.
- (ii) To make the street more attractive.
- (iii) To increase the community value of the street.

The principle employed for street lighting is different from that of interior lighting. There are no walls and ceiling which reflect or diffuse light, hence only direct lighting scheme can be employed and hard shadows and high contrast can not be avoided.

Two general principles are employed in the design of street lighting installations, namely (i) diffusion principle (ii) specular reflection principle

Two general principles are usually employed in the design of street lighting installations, namely

Diffusion and specular reflection principle

**Diffusion principle:** In this case the lamps fitted with suitable reflectors are used. The reflectors are so designed that they may direct the light downwards and spread as uniformly as possible over the road surface. In order to avoid glare the reflectors are made to have a cut-off between  $30^{\circ}$  to  $45^{\circ}$  so that the filament is not visible except from underneath it. The diffusion nature of the road surface causes the reflection of a

certain proportion of the incident light in the direction of the observer. The illumination at any point on the road surface is calculated by applying point to point or inverse-square law method. Over certain properties of the road the surface is illuminated from two lamps and the resultant illumination is the sum of the illuminations due to each lamp.

**Specular Reflection principle:** in this case the reflectors are curved upwards so that the light is thrown on the road at a very large angle of incidence. It is observed that a motorist requires to see objects about 30 meters away. Thus in figure the observer is shown about 30 meters from the object. Much of the light from the lamp  $L_3$  is not reflected towards the observer, whereas most of the light from the lamps  $L_1$  and  $L_2$  is reflected towards him. Thus the object will appear silhouetted against the bright road surface due to lamps at long distance. The requirements of a pedestrian, who requires to see objects in his immediate neighbourhood, is also fulfilled in this method as some light from the lamps falls directly downwards. The method of street lighting is only suitable for straight sections of road. This method is more economical also as compared to the diffusion method of lighting but it suffers from the disadvantages that it produces glare for the motorists.

#### **Illumination level for street lighting and Mounting-height of lamps:**

The illumination depends upon the class street light installation in class A installation, i.e. in important shopping centres and road junctions, illumination level of 30 lumens/m<sup>2</sup> is required in poorly lighted suburban streets, illumination level of 4 lumens/m<sup>2</sup> is sufficient. When the distance apart is not more than 8 times than the height of illuminate. they should be spaced not more than 64 meters.

#### **Types of lamps for street lighting:**

Mercury vapour and sodium discharge lamps have been found to have certain particular advantages for street lighting purposes. The most important of these are low power consumption for a given amount of light. The colour and monochromatic nature of the light produced by the discharge lamps does not matter much in street lighting installation.

#### **FLOOD LIGHTING:**

Flood light means flooding of large surfaces with light from powerful projectors. It is employed to serve one or more of the following purposes.

- (A) Aesthetic Flood-lighting: For enhancing beauty of building at night such as public places, ancient buildings and monuments, religious buildings on important festive occasions.
- (B) Industrial and commercial flood-lighting: for illuminating railway yards, sports stadiums, car parks, construction sites, quarries etc.
- (C) Advertising: For illumination advertisement boards and show-cases. For flood lighting it is necessary to concentrate the light from the light source into a narrow beam. The particular type of reflector and its housing used for concentrating the light into narrow beam is known as flood light projection. The



reflecting surface is the most important part in a projector. This may be made of the silvered glass or chromium plate or stainless steel, the efficiency of silver glass is about 90% while that of polished metal is only about 70%. Metal reflectors being more robust are usually preferred. The casing and its mounting are arranged so that the inclination of the beam can be varied in both a vertical and horizontal direction on site. For permanent installations use of cast metal cases is made to achieve robustness and protection against weather for temporary installations or those in sheltered situations, use of sheet-metal casing is made. The front of the projector is usually of clear glass, often bowed outwards to protect it from the heat of the lamp, use of diffusing glass is made when a diffuse beam is required. As far as possible the projectors should not be visible to the passers by. In some cases the projectors may be housed in ornamental stand standards.

Projects are classified according to the beam standards.

- (i) Narrow beam projectors with beam spread between  $12^{\circ}$ - $25^{\circ}$ . These are used for distance beyond 70 meters.
- (ii) Medium angle projectors-projectors with spread between  $25^{\circ}$ - $40^{\circ}$ . These are used for distance between 30-70 meters.
- (iii) Wide angle projectors- projectors with beam spread between  $40^{\circ}$ - $90^{\circ}$  these are used for distance below 30 meters.

For economic reasons use of wide angle projector with high wattage lamp is encouraged over narrow beam projector with low wattage lamp is more efficient than low power used in narrow projectors. Standard gas-filled tungsten filament lamps of 250,500,1000 watts are used in medium and wide angle projectors which require accurate control of light, special lamps having bunched filaments and known as projector lamps are required.

Location and mounting of projectors: one of the most important factor which affects the choice of projector is the location of the projector. There are two possible locations of projectors in practice. here figure indicates symmetric projector kept 20 to 35 meters away from the surface to be flooded and providing approximating parallel beam having beam spread of  $25^{\circ}$  to  $30^{\circ}$ .

And the next figure indicates when the projector cannot be located away from the building. In such a case, an unsymmetrical reflector mounted in a basement area or on a bracket attached to the building is used which directs more intense light towards the top of the building.

**Flood lighting calculations:** The problem of flood-lighting calculations may be roughly separated into three

**First step:** Illumination level required: the illumination level required depends upon the type of building, the purpose of the flood lighting the amount of conflicting light in the vicinity.

**Second step:** Type of projector : two considerations enter into the choice of a projector .,viz, beam size and light output. The former determines the area covered by the beam and latter the illuminations provided. Beam angle of the projector is decided keeping in view the of projector from the surface

**Third step:** Number of projectors: For any desired intensity over a definite surface the number of projectors required is obtained from the following relation

$$N = \frac{A * E * \text{depreciation factor} * \text{waste light factor}}{(\text{utilisation factor} * \text{wattage of lamp} * \text{luminous efficiency of lamp})}$$

Here N= number of projectors

A= area of surface to be illuminated in square meters

E=illuminates level required in lumens/m<sup>2</sup>.

**COMPARISON BETWEEN TUNGSTEN FILAMENT LAMPS AND FLUORESCENT TUBES:**

Tungsten Filament Lamp	Fluorescent Tubes
1. Voltage fluctuation has comparatively more effect on the light output.	1. Voltage fluctuation has comparatively low effect on light output as the variations in voltage are absorbed in the choke.
2. Luminous efficiency increases with the increase in the voltage of the lamp.	2. Luminous efficiency increases with the increase in wattage and increase in length of tube.
3. It gives light close to natural light. Therefore objects are properly seen.	3. It does not give light close to natural light, therefore, colour rendering is defective.
4. Luminous efficiency of coloured filament lamps is poor because coloured glass is used for this purpose.	4. Different colour light can be obtained by using different composition of fluorescent powder. Hence efficiency is high and better colours are obtained.
5. Due to comparatively high working temperature heat radiations are also present.	5. Due to low working temperature heat radiation is low.
6. Its brightness is more.	6. Its brightness is less.
7. With the time light output is reduced.	7. With the time light output is gradually reduced.
8. Though the life of the lamps varies with the working voltage, however, its normal life is 1000 working hours.	8. Life of fluorescent tubes is not effected so much by variations in voltage but it depends on the frequency

9. The initial cost per lamp is quite low.

10. For same lumens output more lamps are required and working cost is more. Life of the lamp is also low. Hence overall cost of maintenance is more.

of starting. The life of the tube is about 7500 working hours.

9. The initial cost per tube is more.

10. For same lumens output lesser number of tubes are required and wiring cost is more. Life of the tube is comparatively more, therefore replacement cost is low. Hence overall cost of maintenance is low.